
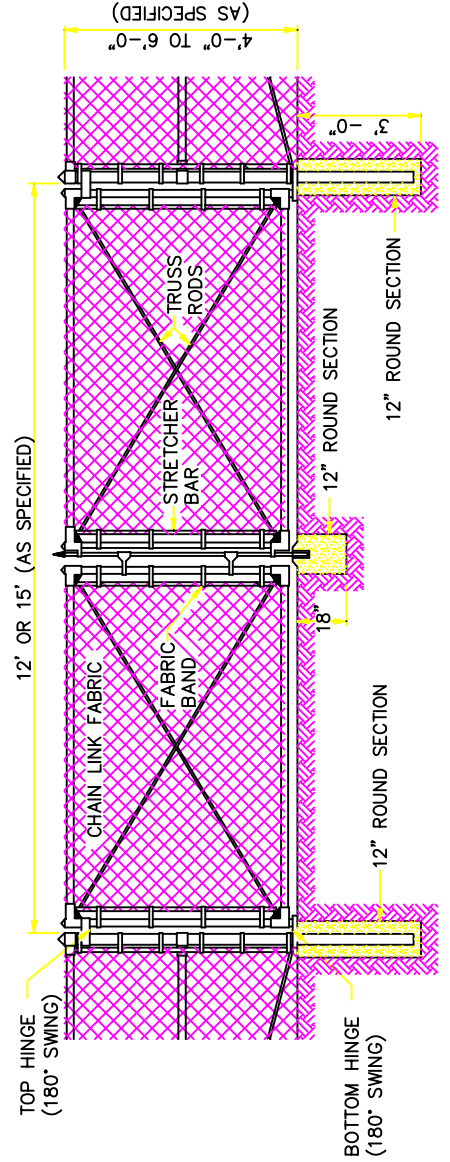


**NOTES:**

1. ALL FITTINGS, FASTENERS, & AND FABRIC TIES SHALL BE HOT DIP GALV.
2. CONC SHALL BE MIN 2500 PSI @ 28 DAYS.
3. PROVIDE BRACE RAIL BETWEEN END POSTS AND LINE POSTS. LENGTHS AS REQ'D.
4. PROVIDE GATE STOPS AND DROP RECEIVERS SET IN CONCRETE, EACH GATE.
5. PROVIDE EXTENSION ARMS ON LINE, END AND CORNER POSTS & GATE POSTS AS REQ'D.
6. PROVIDE SIGHT OBSCURING SLATS WITH ALL WASTEWATER PUMP STATIONS.
7. CENTER BRACE RAIL NOT REQUIRED WITH FENCE HEIGHT OF 5' OR LESS.
8. ALL POSTS AND RAILS TO MATCH FENCE COLOR.

| MEMBER            | NOMINAL DIA (IN)                    | MATERIAL         |
|-------------------|-------------------------------------|------------------|
| BRACE RAIL        | 1.660                               | GALV TUBULAR STL |
| GATE FRAME        | 2.00                                | GALV TUBULAR STL |
| LINE POSTS        | 2.375                               | GALV TUBULAR STL |
| END & CORNER POST | 2.875                               | GALV TUBULAR STL |
| CHAIN LINK FABRIC | 9 GA. W/GREEN OR BLACK PVC COATING. |                  |
| GATE POST         | GATE OPENING (ft)                   | MATERIAL         |
|                   | 12' OR 15'                          | GALV TUBULAR STL |
|                   | NOMINAL DIA (IN)                    | 4                |

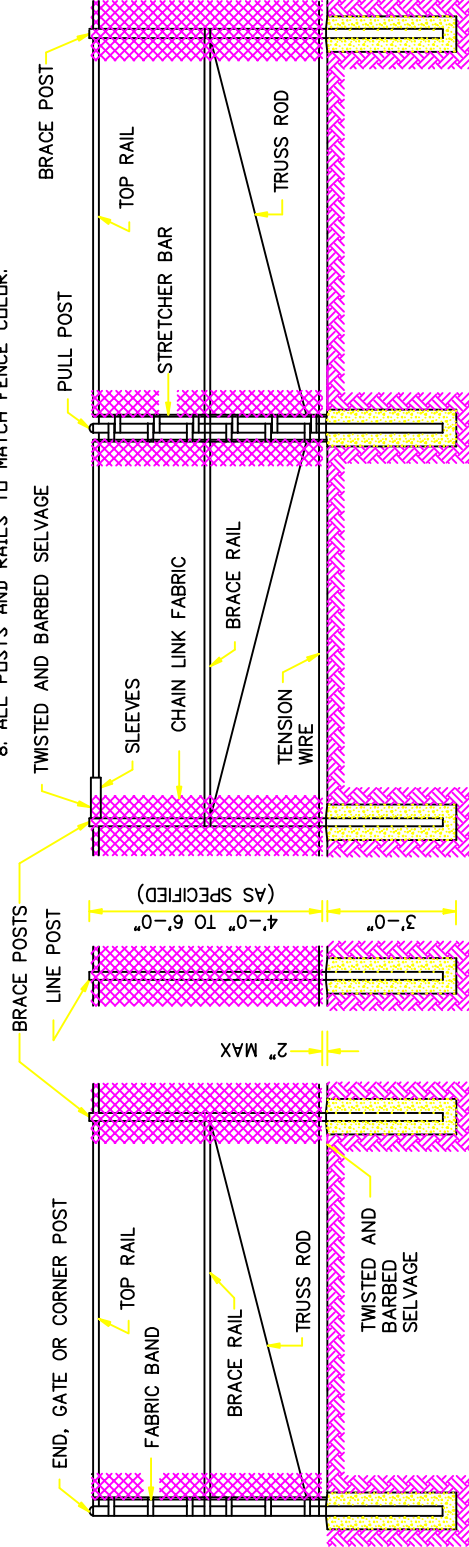

CLACKAMAS COUNTY  
150 BEAVERCREEK ROAD  
OREGON CITY, OR 97045

APPROVAL DATE: 2013 SCALE: N.T.S.

**Storm - SW FACILITY  
FENCING**

STANDARD  
DRAWING

**SWM  
ST-14.0**