


NOTE: MANHOLE LID TO BE 6" ABOVE FINISH GRADE IN EASMENTS  
BARREL SECTION IS 3'

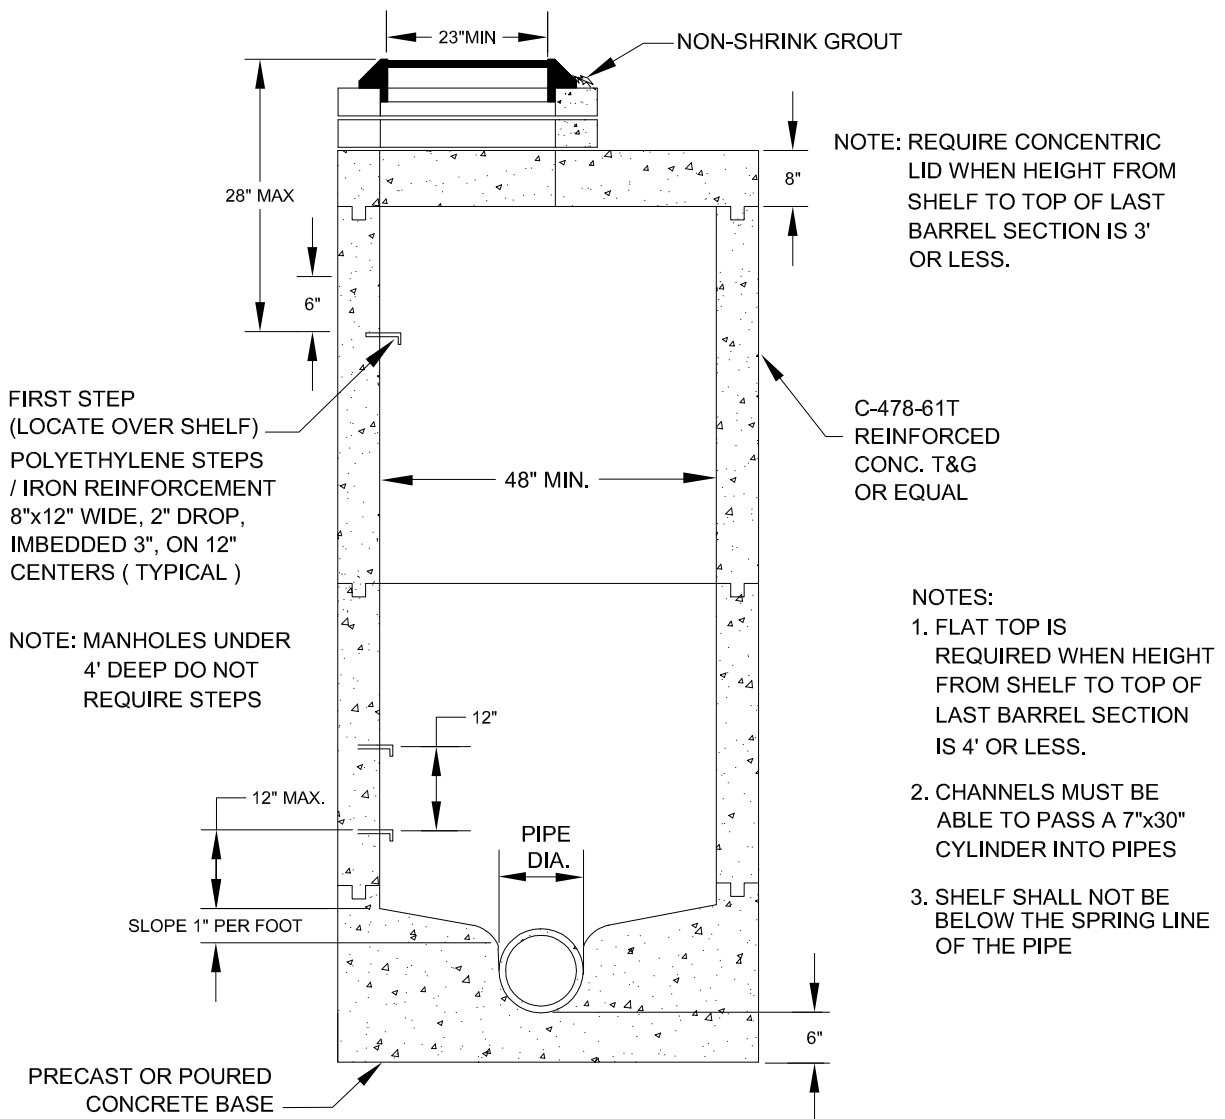

- NOTES:
1. FLAT TOP IS REQUIRED WHEN HEIGHT FROM SHELF TO TOP OF LAST BARREL SECTION IS 4' OR LESS.
  2. CHANNELS MUST BE ABLE TO PASS A 7"x30" CYLINDER INTO PIPES
  3. SHELF SHALL NOT BE BELOW THE SPRING LINE OF THE PIPE

### MANHOLE-FLAT TOP