
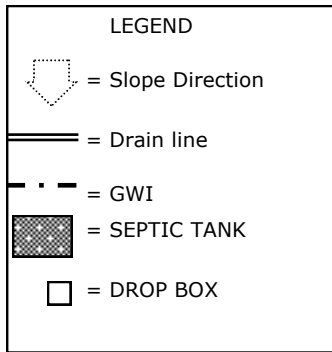


# GROUNDWATER INTERCEPTOR


## CURTAIN DRAIN

### SIDE VIEW

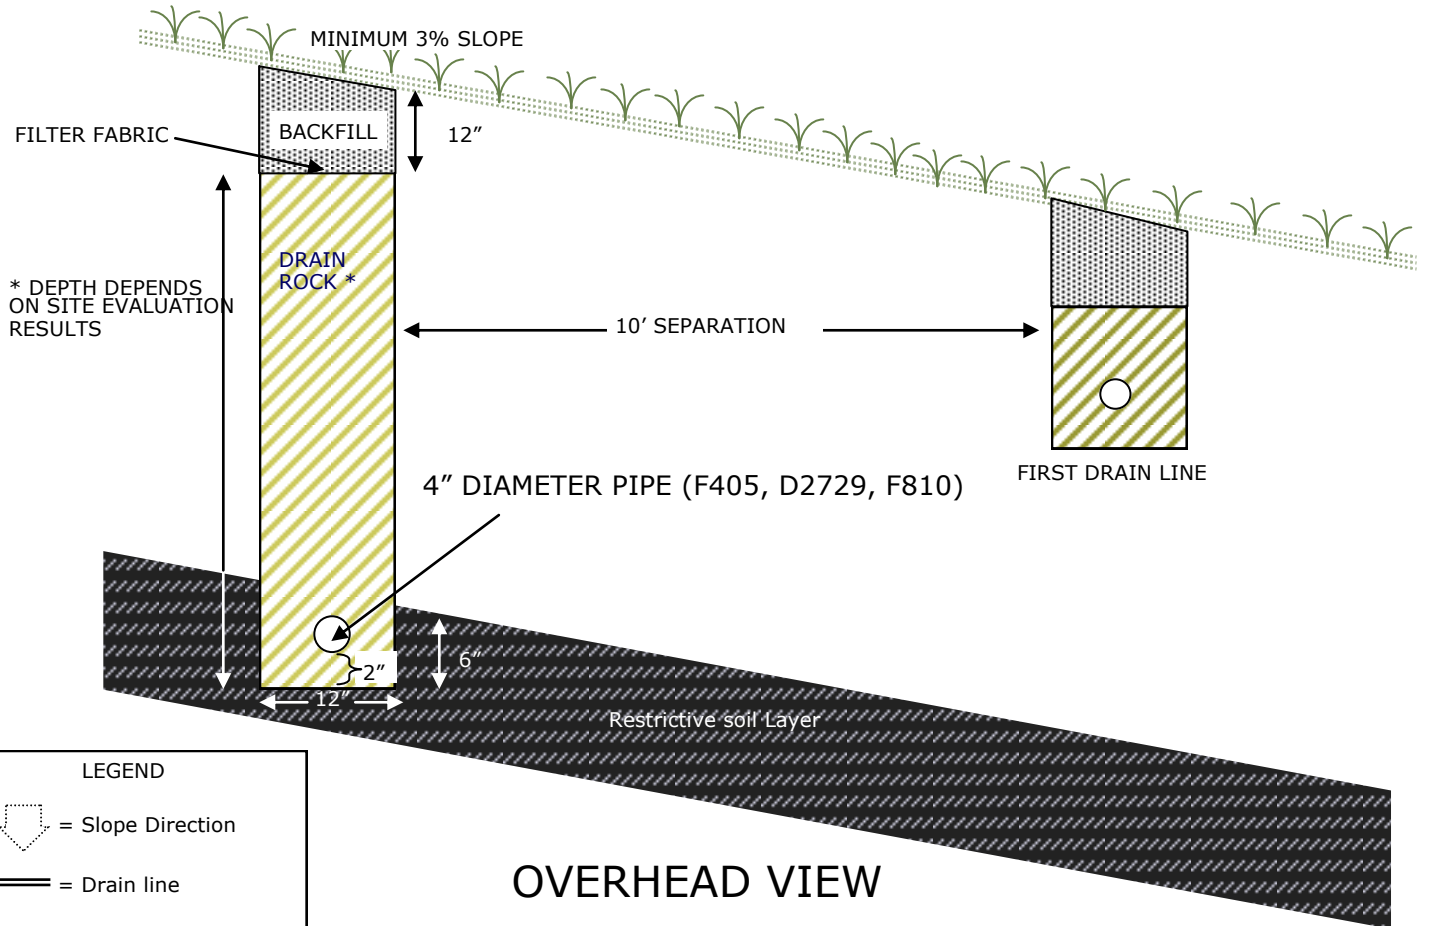

### OVERHEAD VIEW

(NOT TO SCALE)

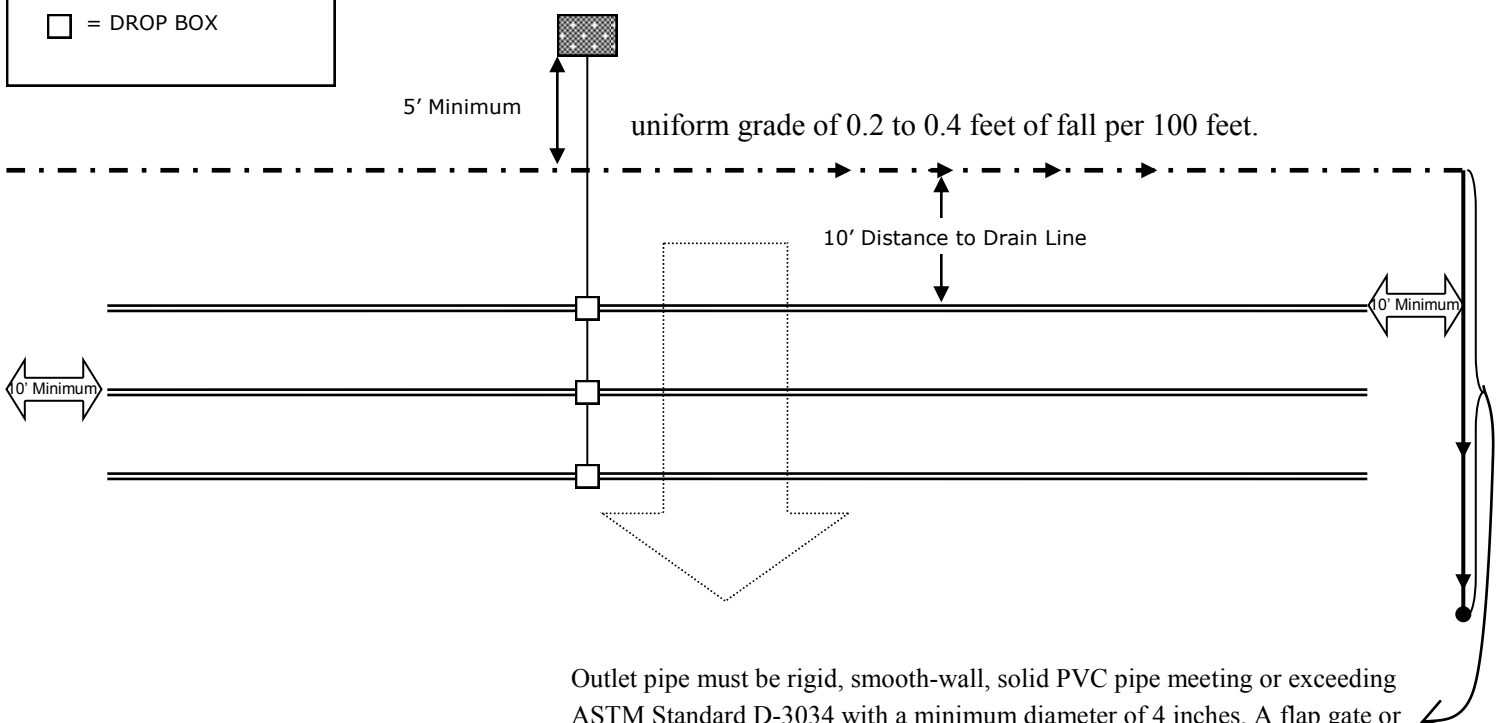

Outlet pipe must be rigid, smooth-wall, solid PVC pipe meeting or exceeding ASTM Standard D-3034 with a minimum diameter of 4 inches. A flap gate or rodent guard must be installed, must discharge to a free draining location.