


TRUNCATED DOME DETAIL



RAMP TEXTURE PATTERN
(TRUNCATED DOMES)
DETAIL

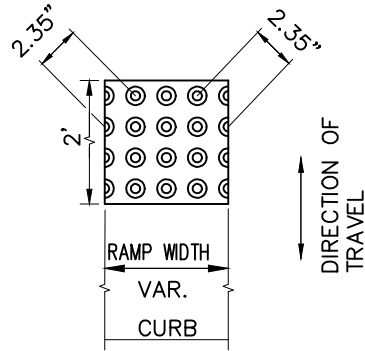

SIDEWALK SURFACING DETAIL

NOTES

1. CONCRETE AND MISC. MATERIALS USED IN CONSTRUCTION SHALL CONFORM TO CURRENT OREGON STANDARD SPECIFICATIONS FOR CONSTRUCTION. DETECTABLE WARNINGS ON WALKING SURFACES AS PER ADA REQUIREMENTS.
2. DETECTABLE WARNINGS SHALL CONSIST OF RAISED TRUNCATED DOMES WITH A DIAMETER OF NOMINAL 0.9 in (23 mm) A HEIGHT OF NOMINAL 0.2 in (5 mm) AND A CENTER-TO-CENTER SPACING OF NOMINAL 2.35in (60mm) AND SHALL CONTRAST VISUALLY WITH ADJOINING SURFACES, EITHER LIGHT-ON-DARK, OR DARK-ON-LIGHT. THE MATERIAL USED TO PROVIDE CONTRAST SHALL BE AN INTEGRAL PART OF THE WALKING SURFACE. DETECTABLE WARNINGS USED ON INTERIOR SURFACES SHALL DIFFER FROM ADJOINING WALKING SURFACES IN RESILIENCY OR SOUND-ON-CANE CONTACT.
3. EXPANSION JOINT SPACING EVERY 45' MIN. OR AT EQUAL INTERVALS CORRESPONDING TO CURB LINE. CONTRACTION JOINT EVERY 15'. TOOLED JOINT EVERY 5 FEET.
4. THE SURFACE FINISH SHALL BE CROSS BROOMED.
5. CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3300 PSI IN 28 DAYS.
6. APPROVAL MUST BE OBTAINED FROM ENGINEERING FOR SIDEWALK AT ANY LOCATION IN THE PUBLIC ROAD R/W.

| | | | | | | | |
|-----------------|-------------|-----------|---|---|---|--|-----------------------------|
| REVISION | DATE | BY | DEPARTMENT OF TRANSPORTATION AND DEVELOPMENT |  | APPROVAL DATE: 2/1/13 | SCALE: N.T.S. | STANDARD DRAWING |
| EDIT NOTE 1 | 12/12 | RN | | | 150 BEAVERCREEK ROAD OREGON CITY, OR 97045 | STANDARD SIDEWALK & CURB RAMP NOTES & DETAILS | S960 |
| EDIT NOTE 6 | 12/12 | RN | | | | | |
| | | | | | | | |